

CASALI® WATERPROOFING SYSTEMS

DRAWING DETAIL:
CT-5-0001

DRAWN BY:
HAYDEN L.

DATE:
20/01/2016


COLD ROOF - MEMBRANE INTERNAL BOX GUTTER

SCALE:
NTS

VERIFIED BY:
DOUG J.

VERSION:
1.0

NOTE: INTERNAL GUTTER SHALL BE SIZED AND CONSTRUCTED TO SUIT ROOF CATCHMENT AREA. IN NO CASE SHALL THE CROSS SECTIONAL AREA OF THE GUTTER BE LESS THAN 4000mm², REFER TO NZBC E1/AS1 PARAGRAPH 5.1.4. ALSO MIN GUTTER WIDTH TO BE 300mm WITH MINIMUM FREEBOARD REQUIREMENT OF 50mm REFER NZBC E2/AS1 FIGURE 64 PARAGRAPH 8.5.10.

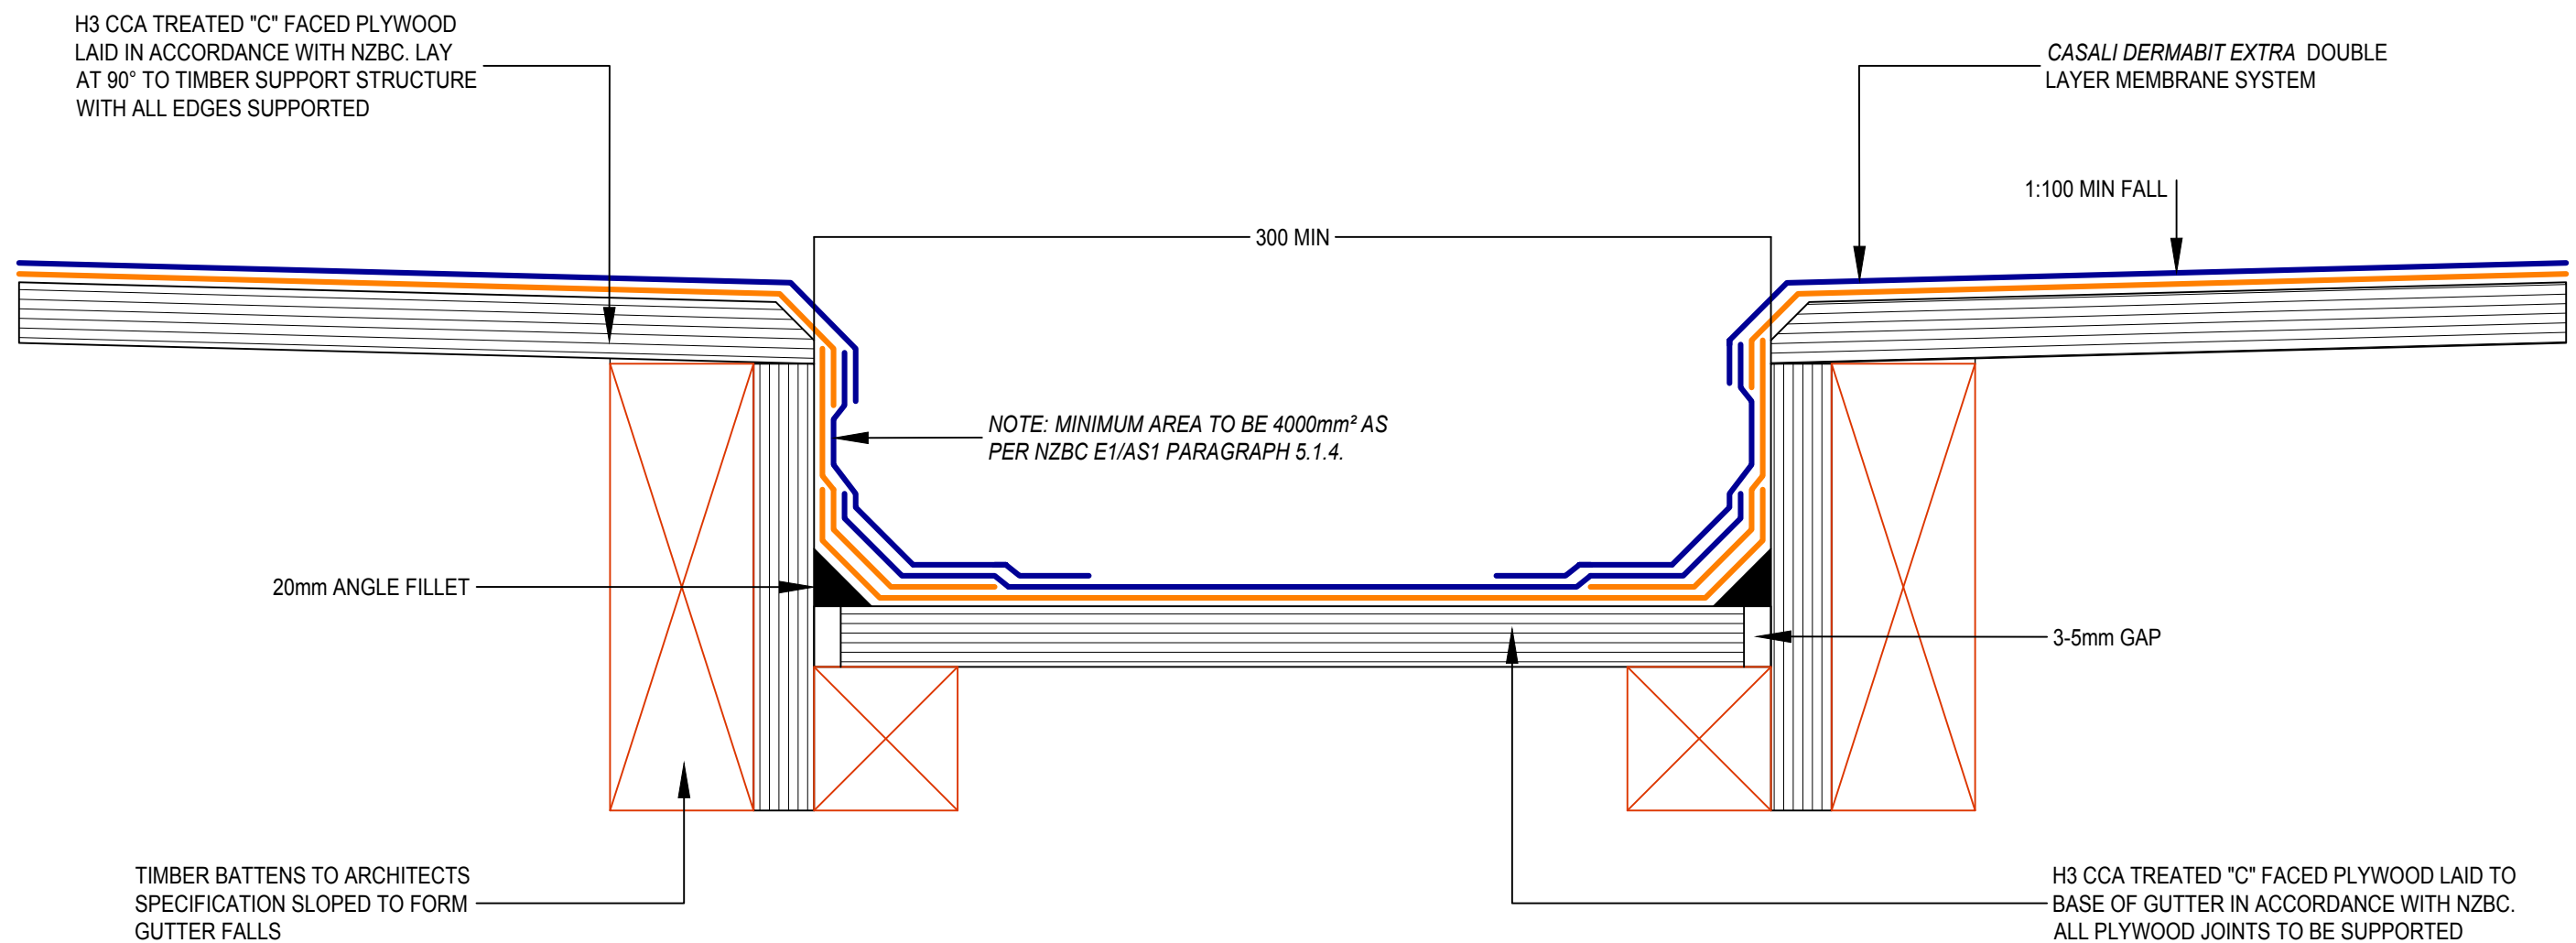

The information and data contained herein are believed to be accurate and reliable. This information does not constitute a warranty and should be used in conjunction with the project specification document and Quality Assurance manual supplied by Allco Waterproofing Solutions Ltd. Please contact Allco Waterproofing Solutions Ltd with any questions or deviations from this information. © Allco Waterproofing Solution Ltd 2011



For Technical Advice Contact:
Web: www.allco.co.nz
Email: info@allco.co.nz
Telephone: 09 448 1185
Facsimile: 09 448 1186